



Institute of Thermal Engineering



Graz University of Technology

S C I E N C E • P A S S I O N • T E C H N O L O G Y

Sector Coupling Potentials of a 5th Generation District Heating and Cooling Network


Hermann Edtmayer, Peter Nageler, Richard Heimrath, Thomas Mach, Christoph Hochenauer

6th International Conference on Smart Energy Systems, 6-7 October 2020, Aalborg, Denmark



The FGZ CDHC-network

Status quo 2020

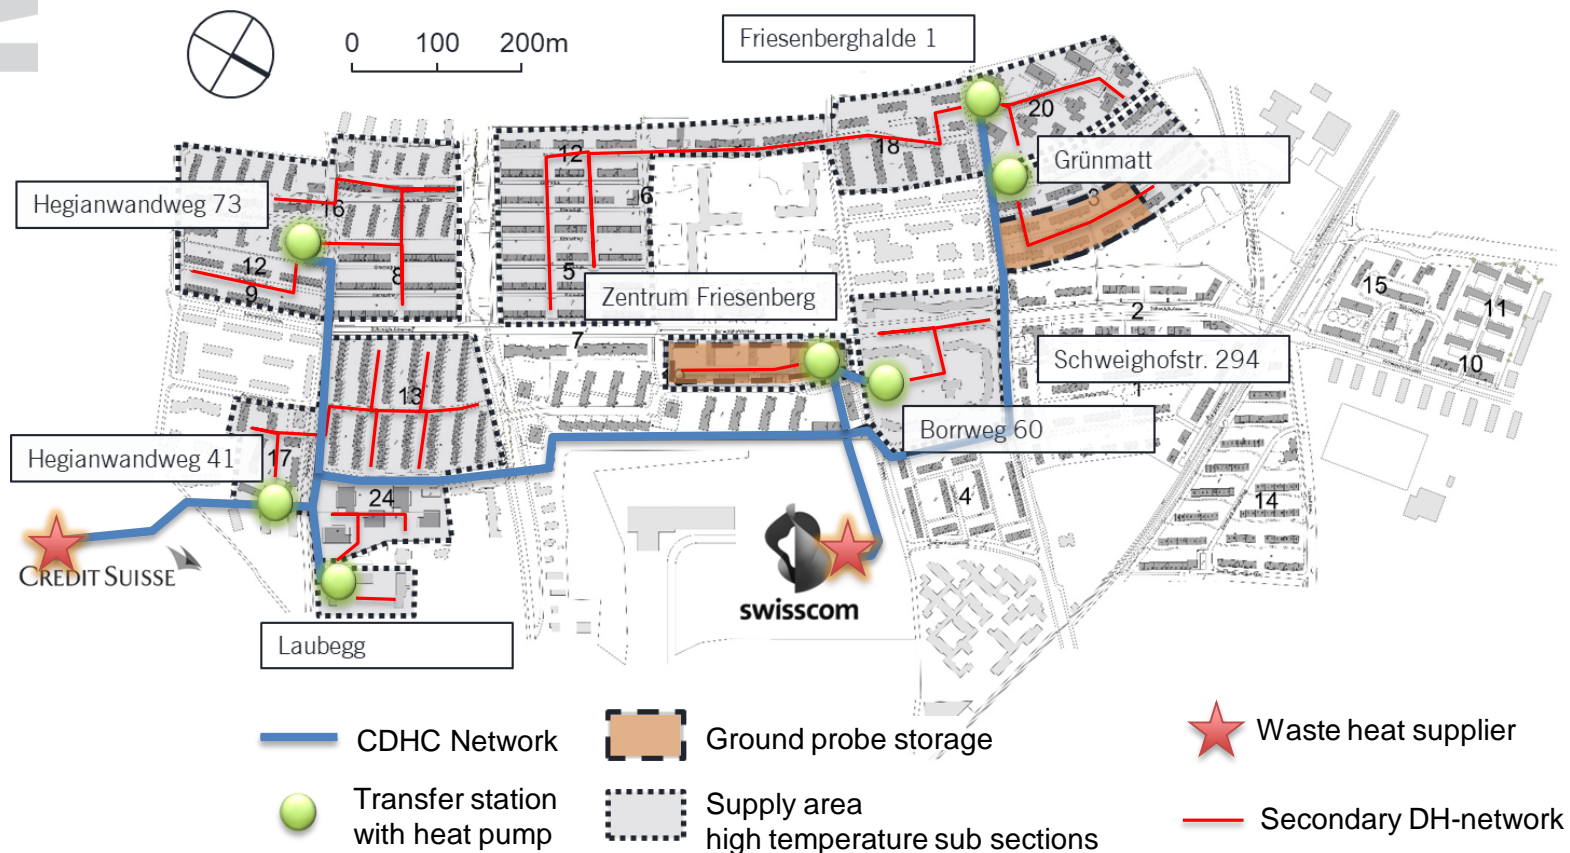


Location: Friesenberg, Zürich, Switzerland
 Owner: Familienheim-Genossenschaft Zürich
 Total nr. of housing units: 2200
 Total nr. of residents: 5500

Connected housing units: 1000
 Installed heat pump power: 9 MW
 Nr. of ground probes installed: 266 at 250m


Start of operation:
 2014 with 400 hu, 3,4 MW hpp, 153 probes
 Final completion planned:
 2050, with 2200hu, 14 MW hpp, 453 probes





Co-simulation framework in IDA ICE

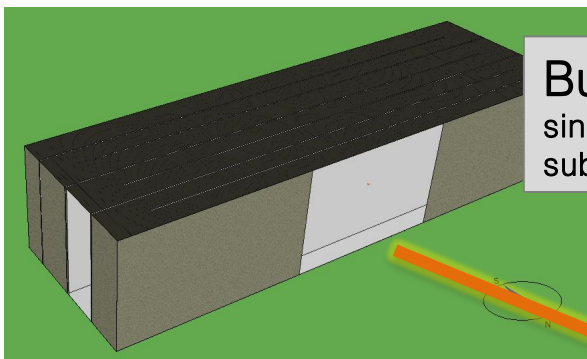


Building model
single building
substitute for sub area

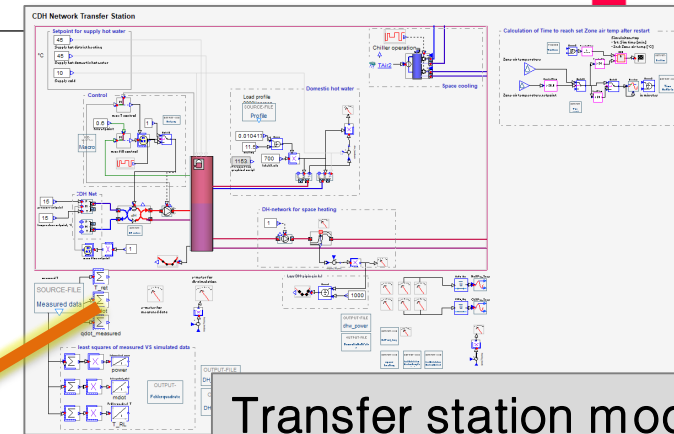

Transfer station model
heat pump, hot water storage,
domestic hot water, space heating
secondary side dh-network

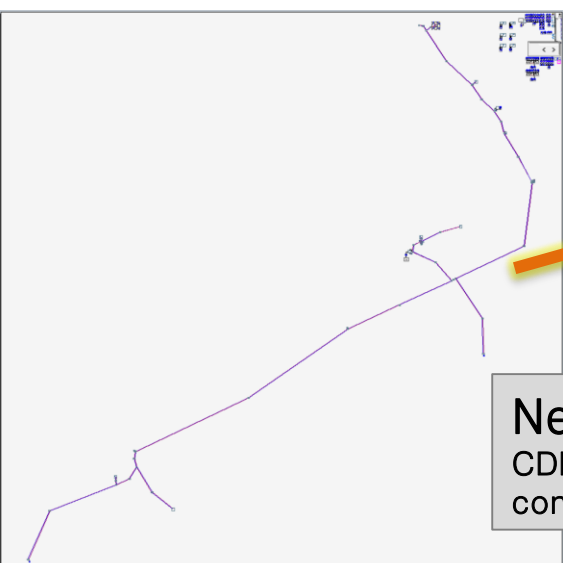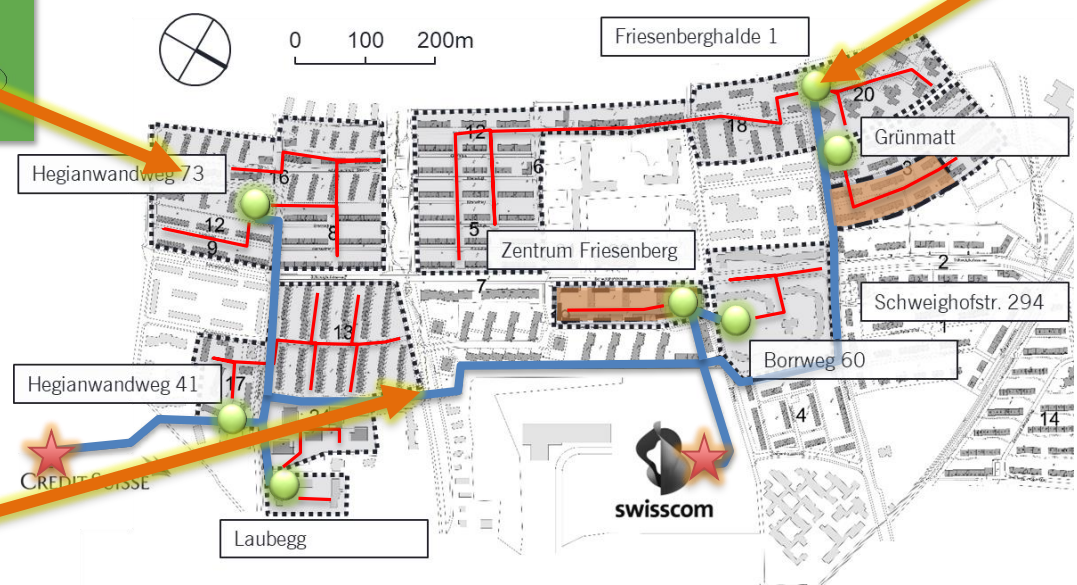


Network model
CDHC network
connecting transfer stations

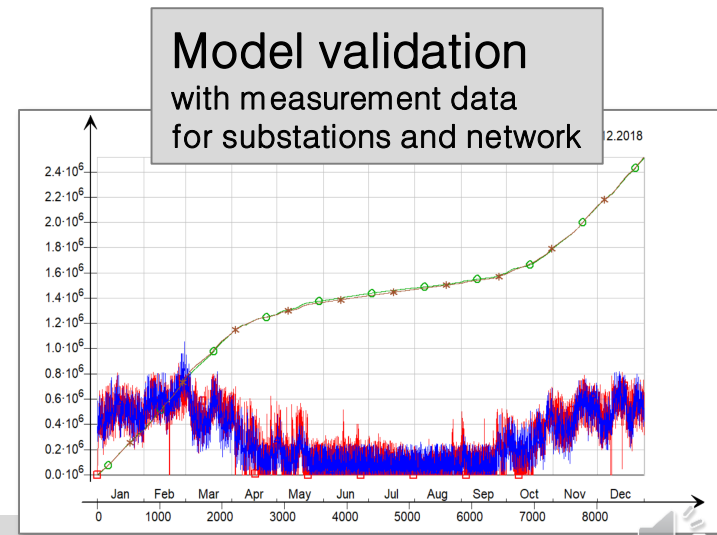


Step response test with constant boundary conditions

DIN EN ISO 7730
Thermal comfort in buildings

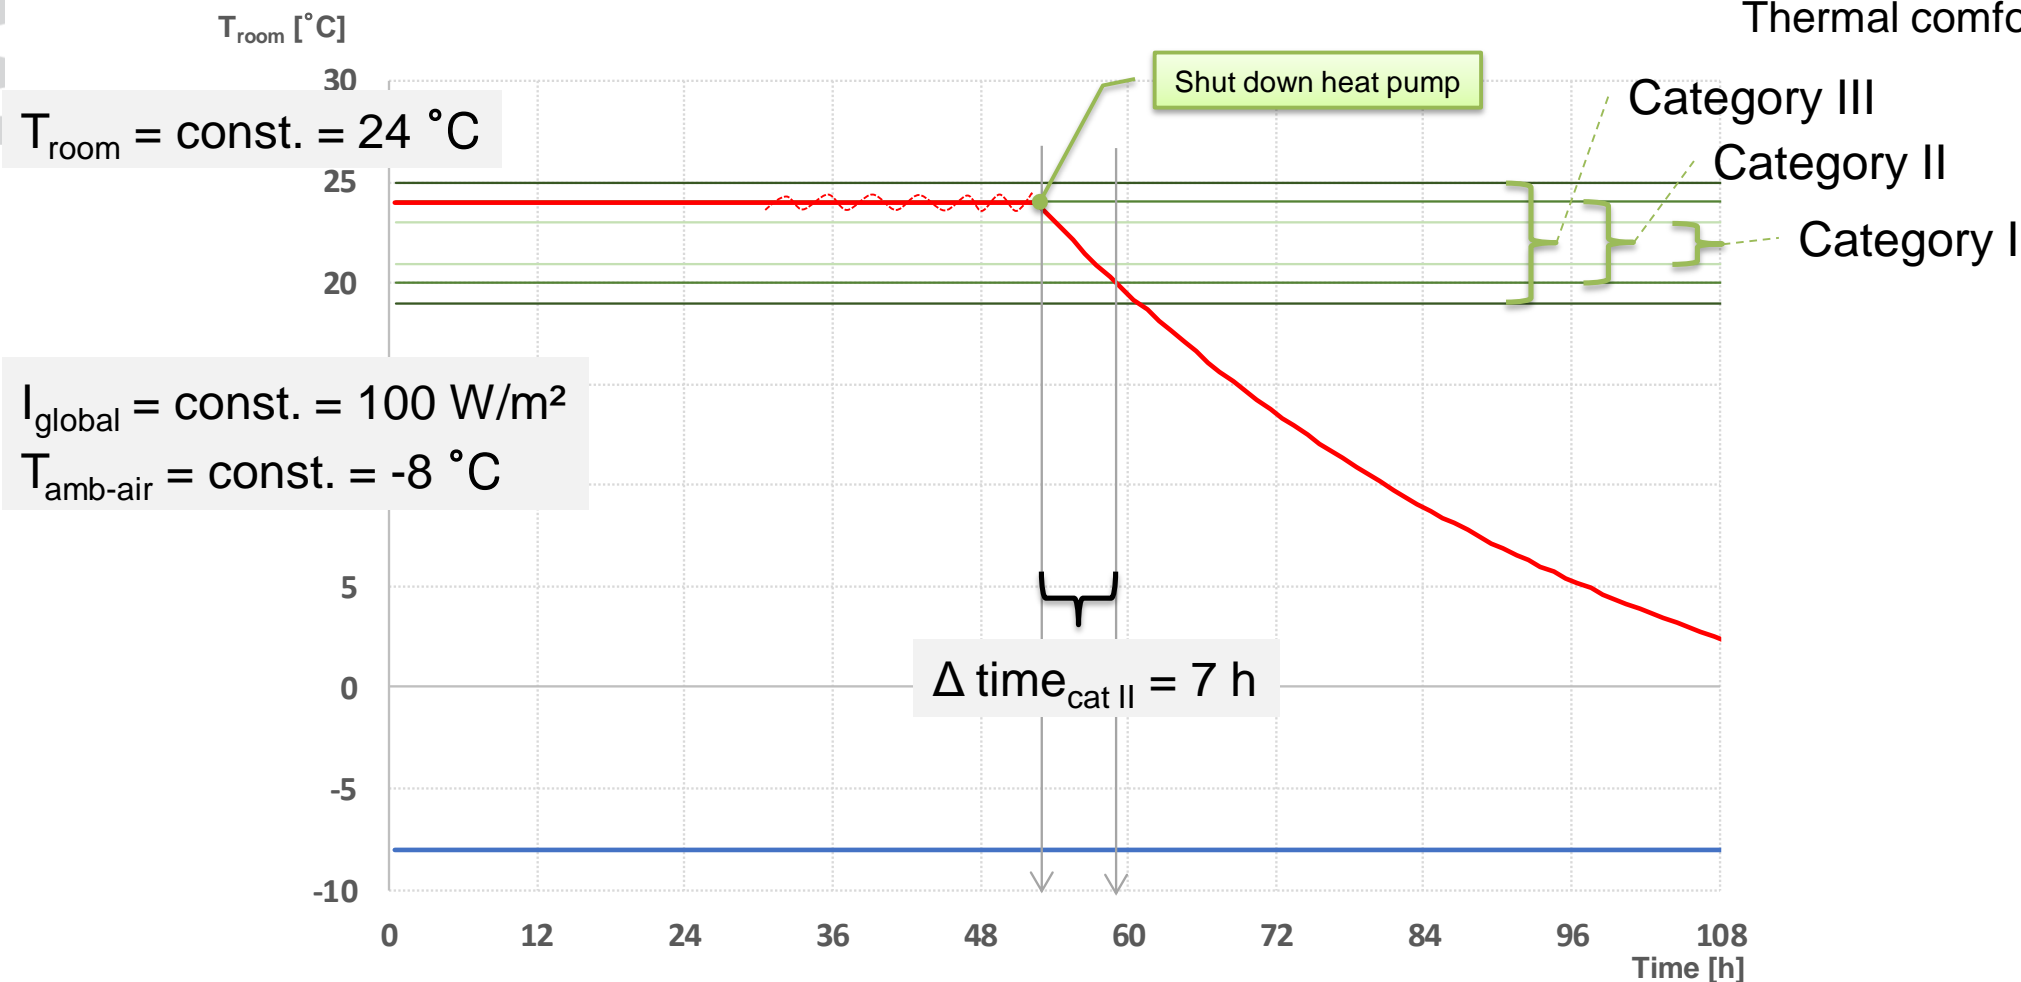

Dynamic network simulation with energy market price signal


24h moving average control

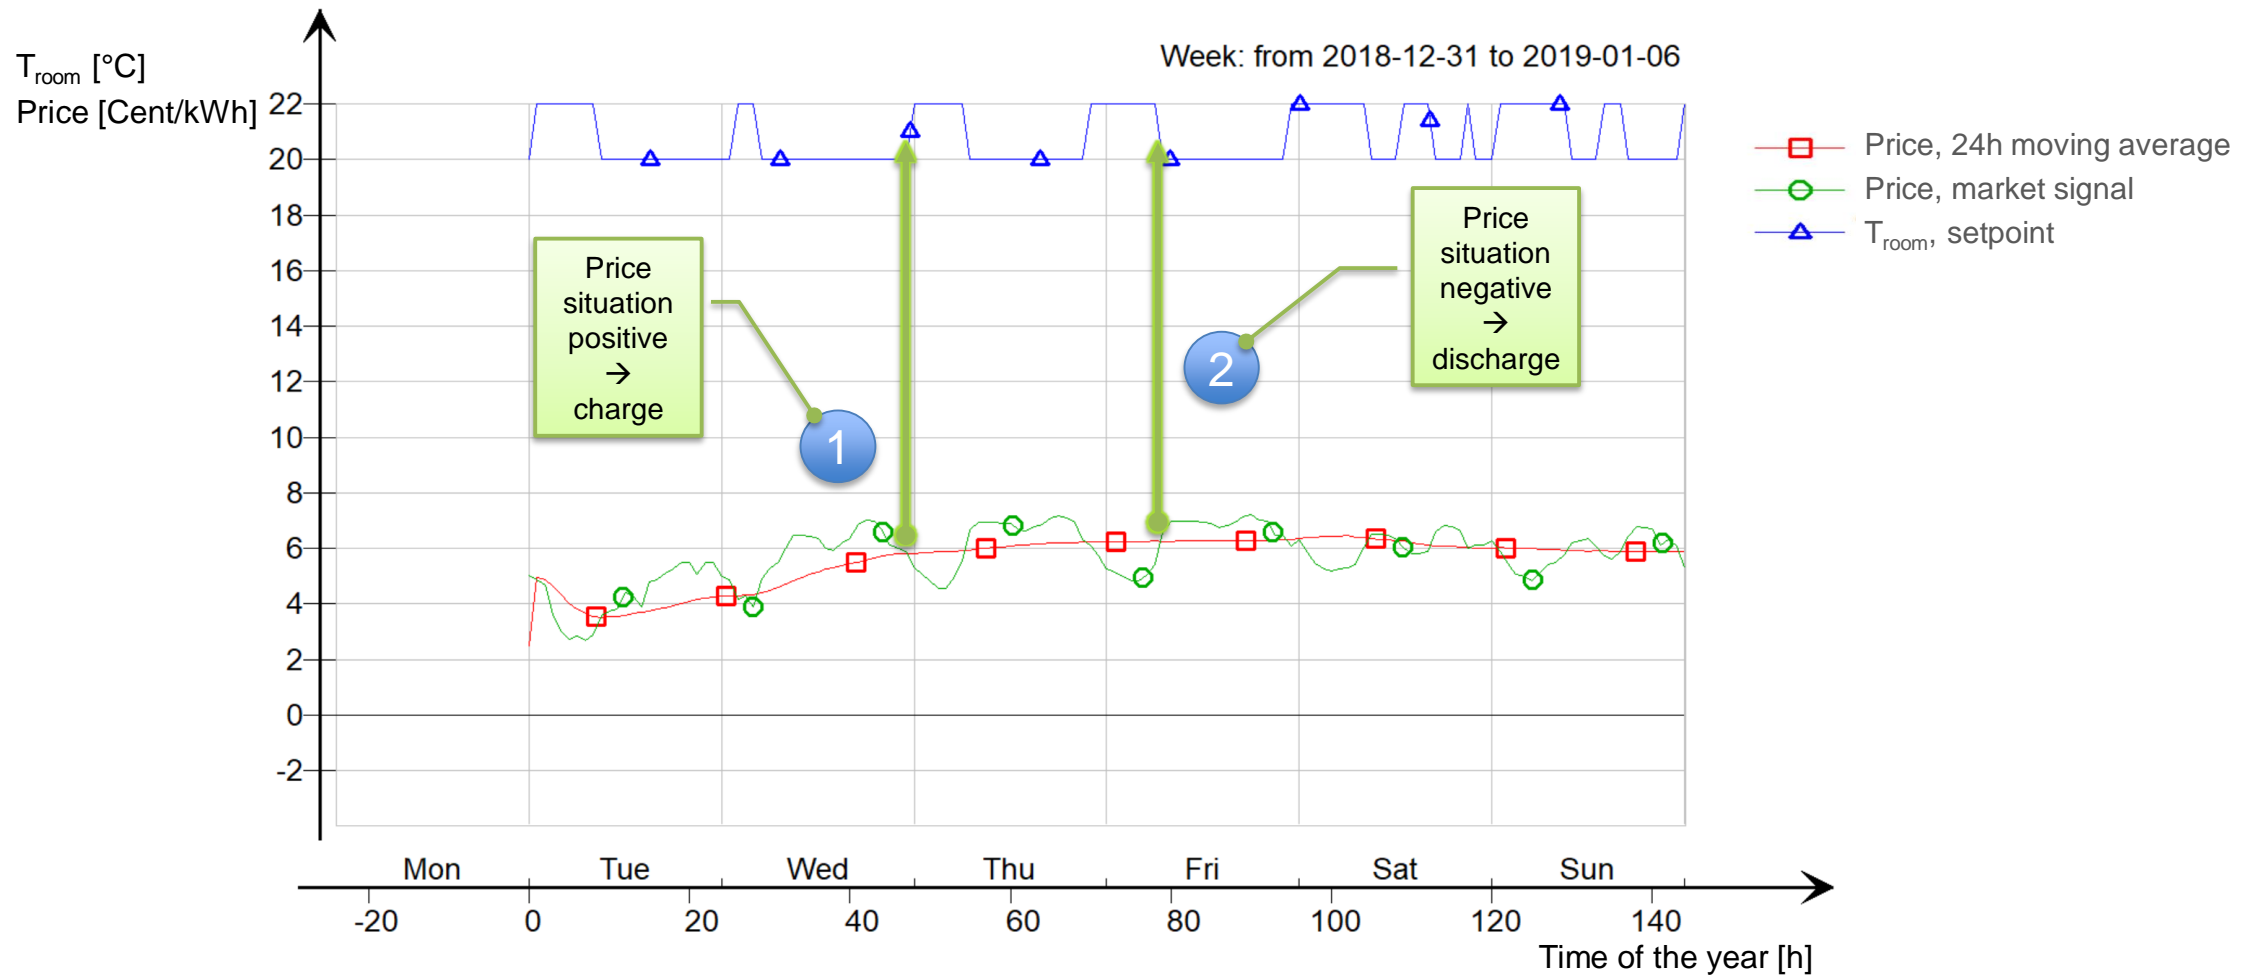

Step response test, 20°C and 24°C


Cooldown test

Water radiator system, 0% cloud cover and 10°C sun-air temperature

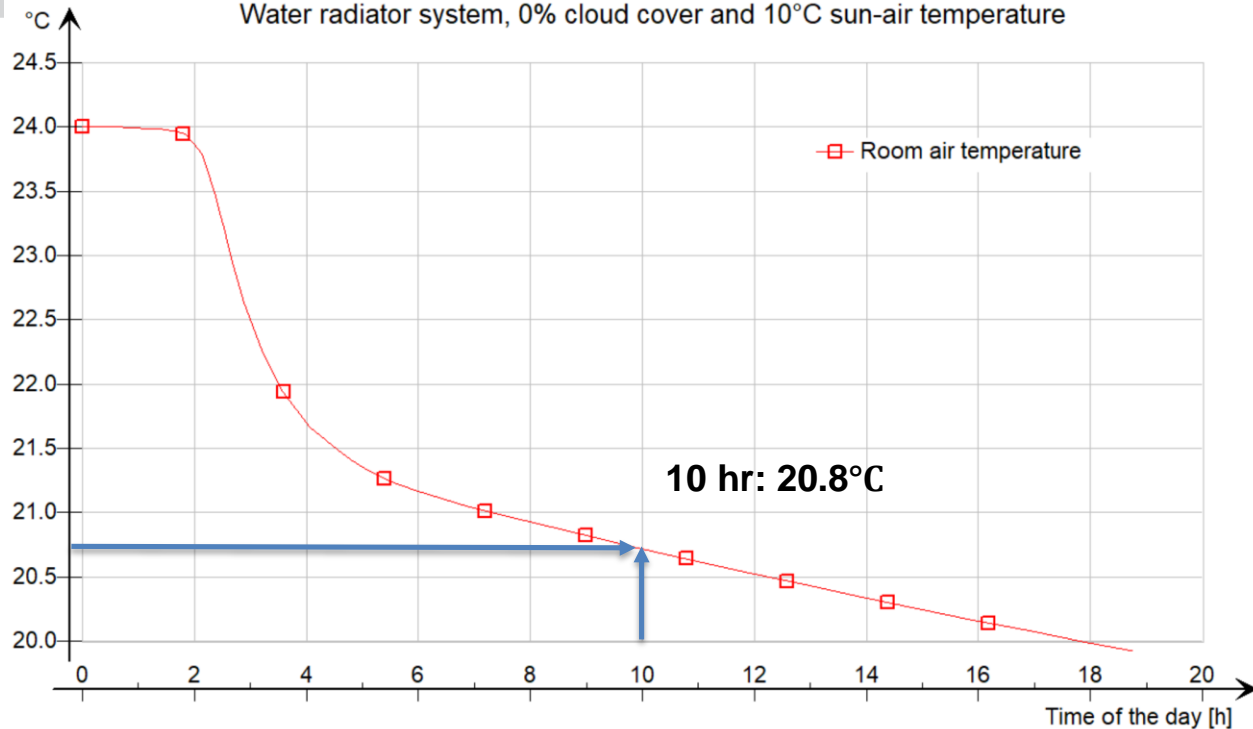


Heat-up test

Water radiator system, 0% cloud cover and 0°C sun-air temperature, 20°C to 24°C

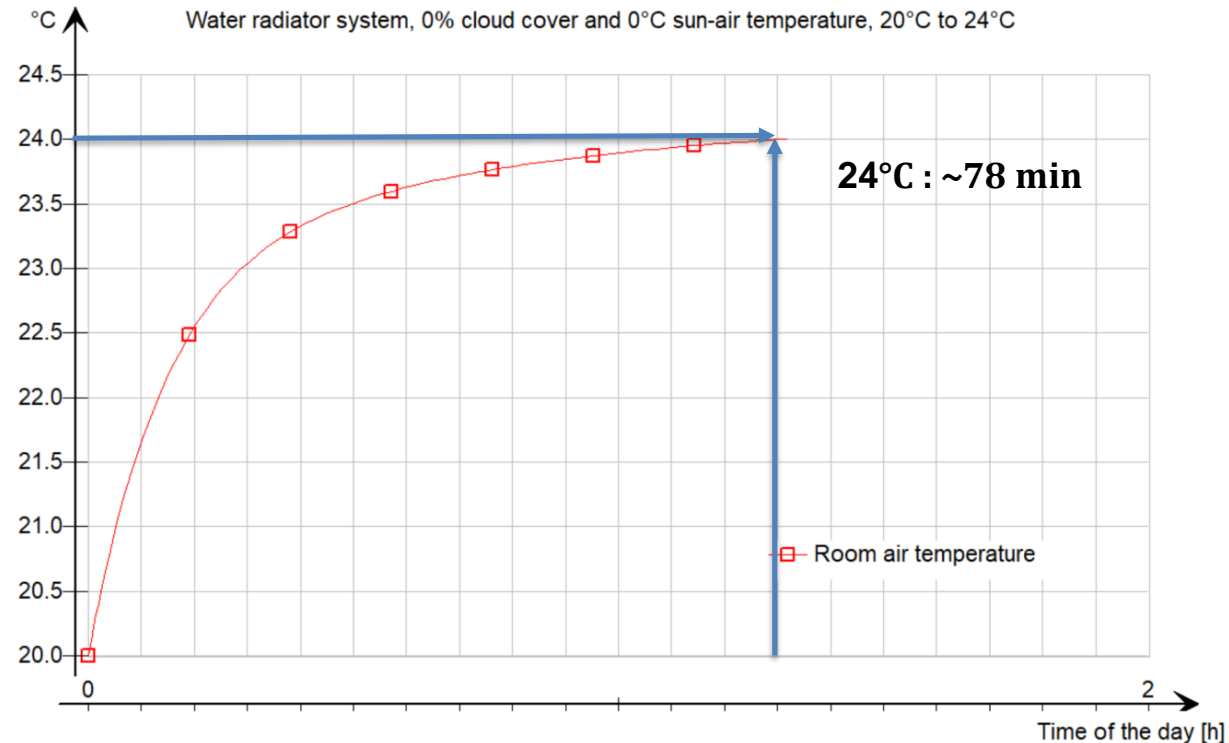


Characteristic diagrams of the step response test

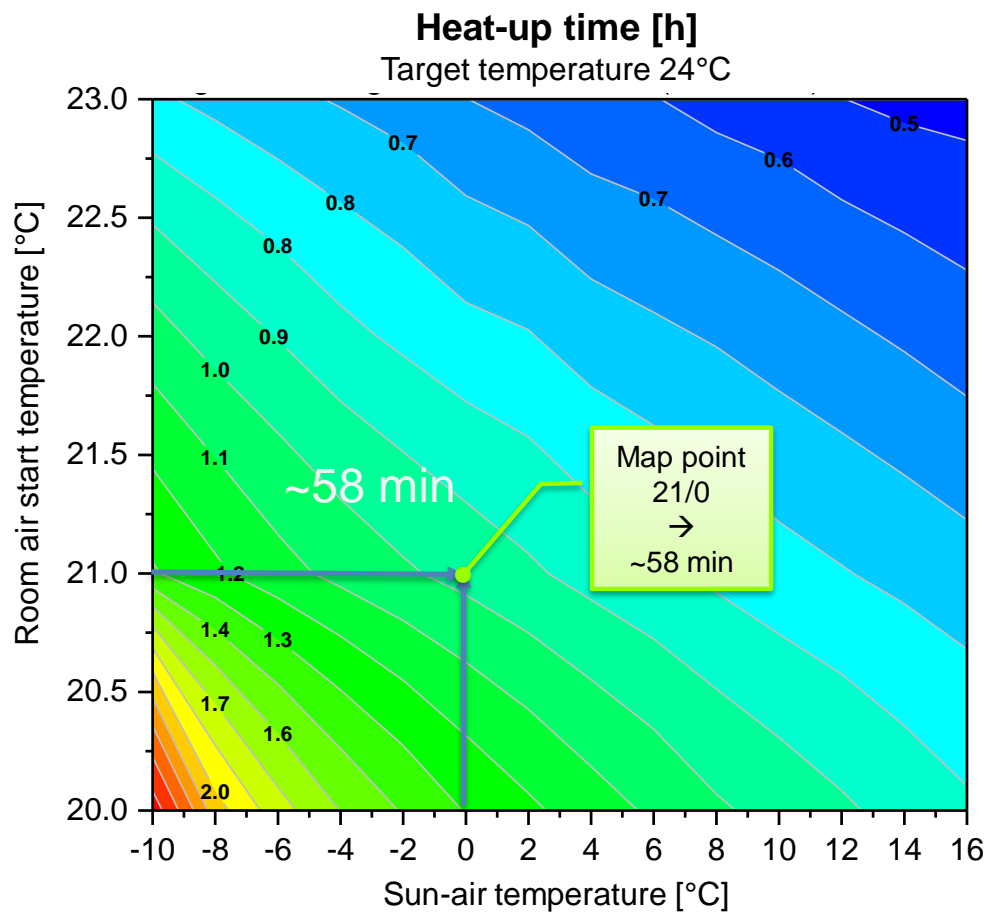

24 °C

↑




20 - 23 °C

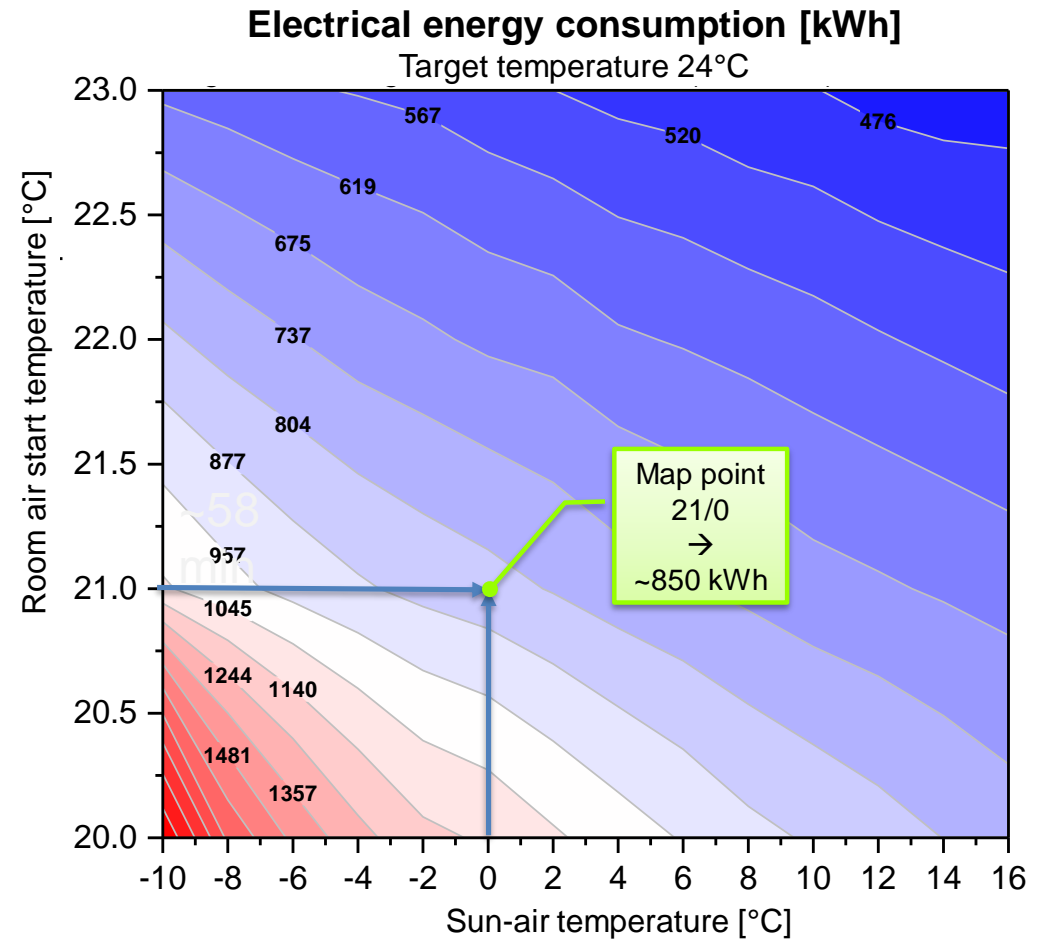

Revenue potentials of the network

Investigation of different control strategies with energy spot market tariff

Szenario	Room air temperature setpoint
Standard	constant 22°C
Low-Temp	constant 20°C
High-Temp	constant 24°C
Moving average	variable: if 24h MA > tariff then 22°C else 20°C

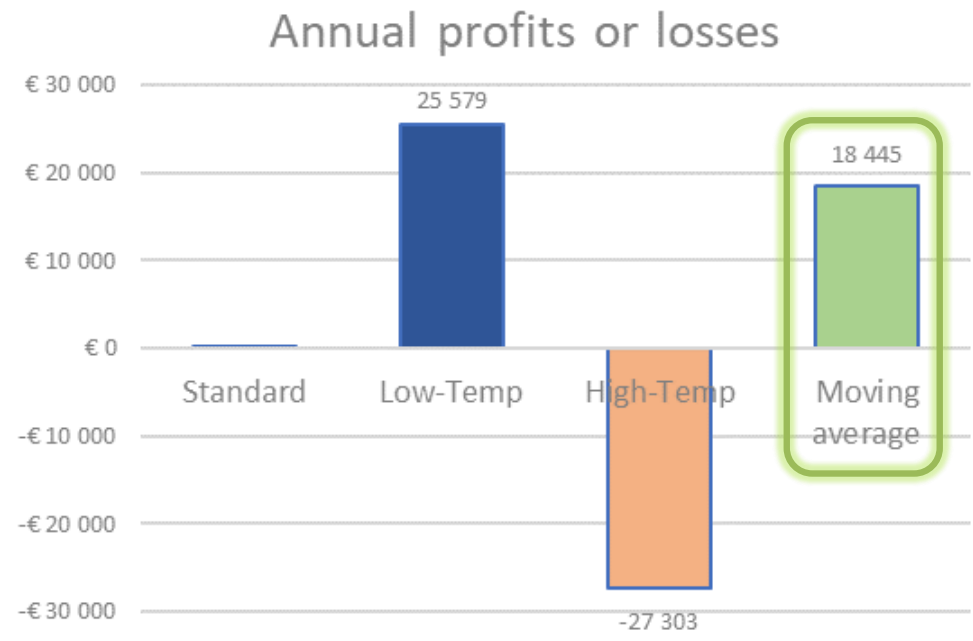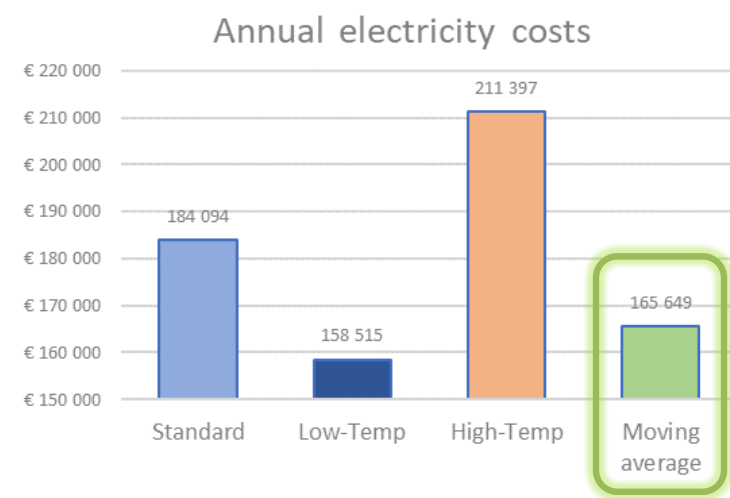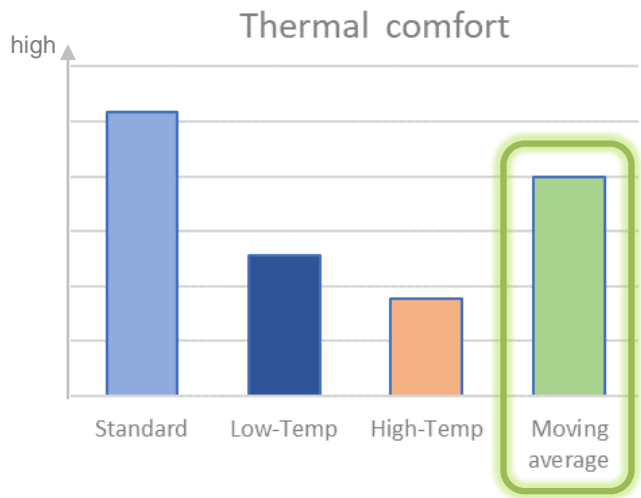

Possibilities & challenges

Possibilities

- System flexibilities available
- Extra revenues with existing system topology possible
- Numerous optimisation possibilities of the network
- Simulation model for further investigation/optimisation available

Challenges

- System complexity for 5GCDH-networks
- Large number of influencing variables on the system behavior
- Modelling of undirected thermal networks
- Still high work effort for detailed simulation needed

Thank you for your attention!

Contact

Hermann Edtmayer

Institute of Thermal Engineering
Graz University of Technology
+43 (316) 873 7811
hermann.edtmayer@tugraz.at
www.iwt.tugraz.at



Institute of Thermal Engineering



Graz University of Technology

Links

The research project 'DeStoSimKaFe'

- [TU Graz](http://www.tugraz.at)
- [AEE Intec](http://www.aee-intec.at)
- [Researchgate](https://www.researchgate.net)
- [Austrian funding organisation FFG](http://www.ffg.at)

Project partners

- AEE Intec
<http://www.aee-intec.at>
- anex Ingenieure AG
<https://www.anex.ch/de/>
- Energieinstitut Vorarlberg
<https://www.energieinstitut.at/>
- Ochsner Process Energy Systems
<https://processenergysystems.com/>
- 3F Solar Technologies
<https://www.3f-solar.at/>



Sector coupling with CDHC Networks

Heat pump operation strategy

- Installed electrical power & systems thermal flexibility
- Large industrial heat pumps → no pooling necessary

Power to heat potentials


- Energy spot market
 - Use combination of cheap market prices and heat storage capacities
- Grid stability services
 - Use installed electrical heat pump power and heat storage capacities

Flexibility potentials


- Peak clipping
 - Lower the costs of peak power contract
- Peak power for other applications
 - Utilise unused peak power possibilities for e.g. charging stations

Simulation framework - IDA ICE model

Sub section with transfer station and substitute building

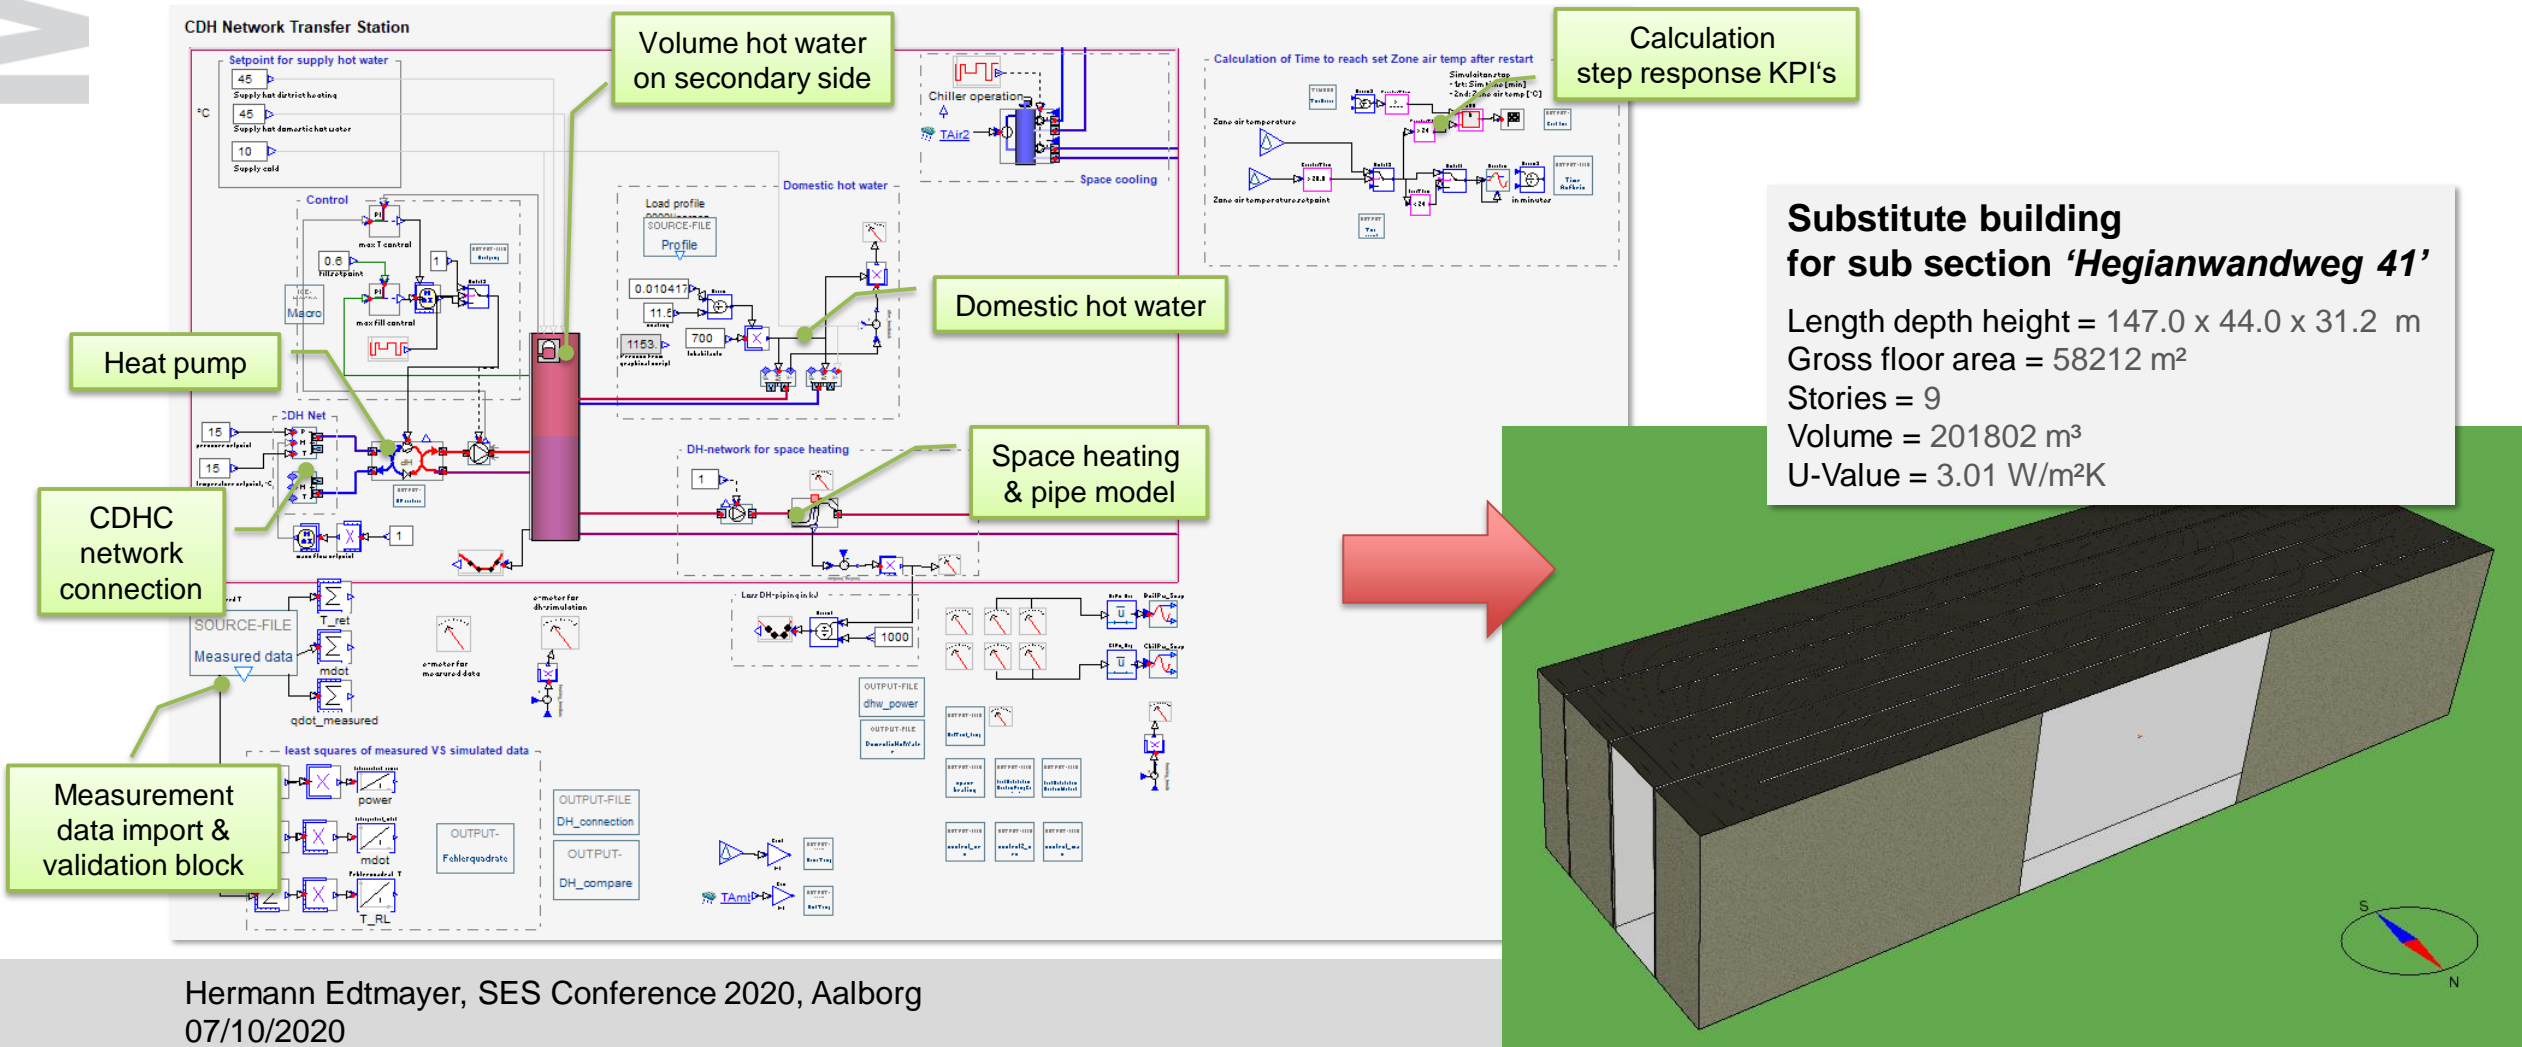

Validation of substitute building with measurement data

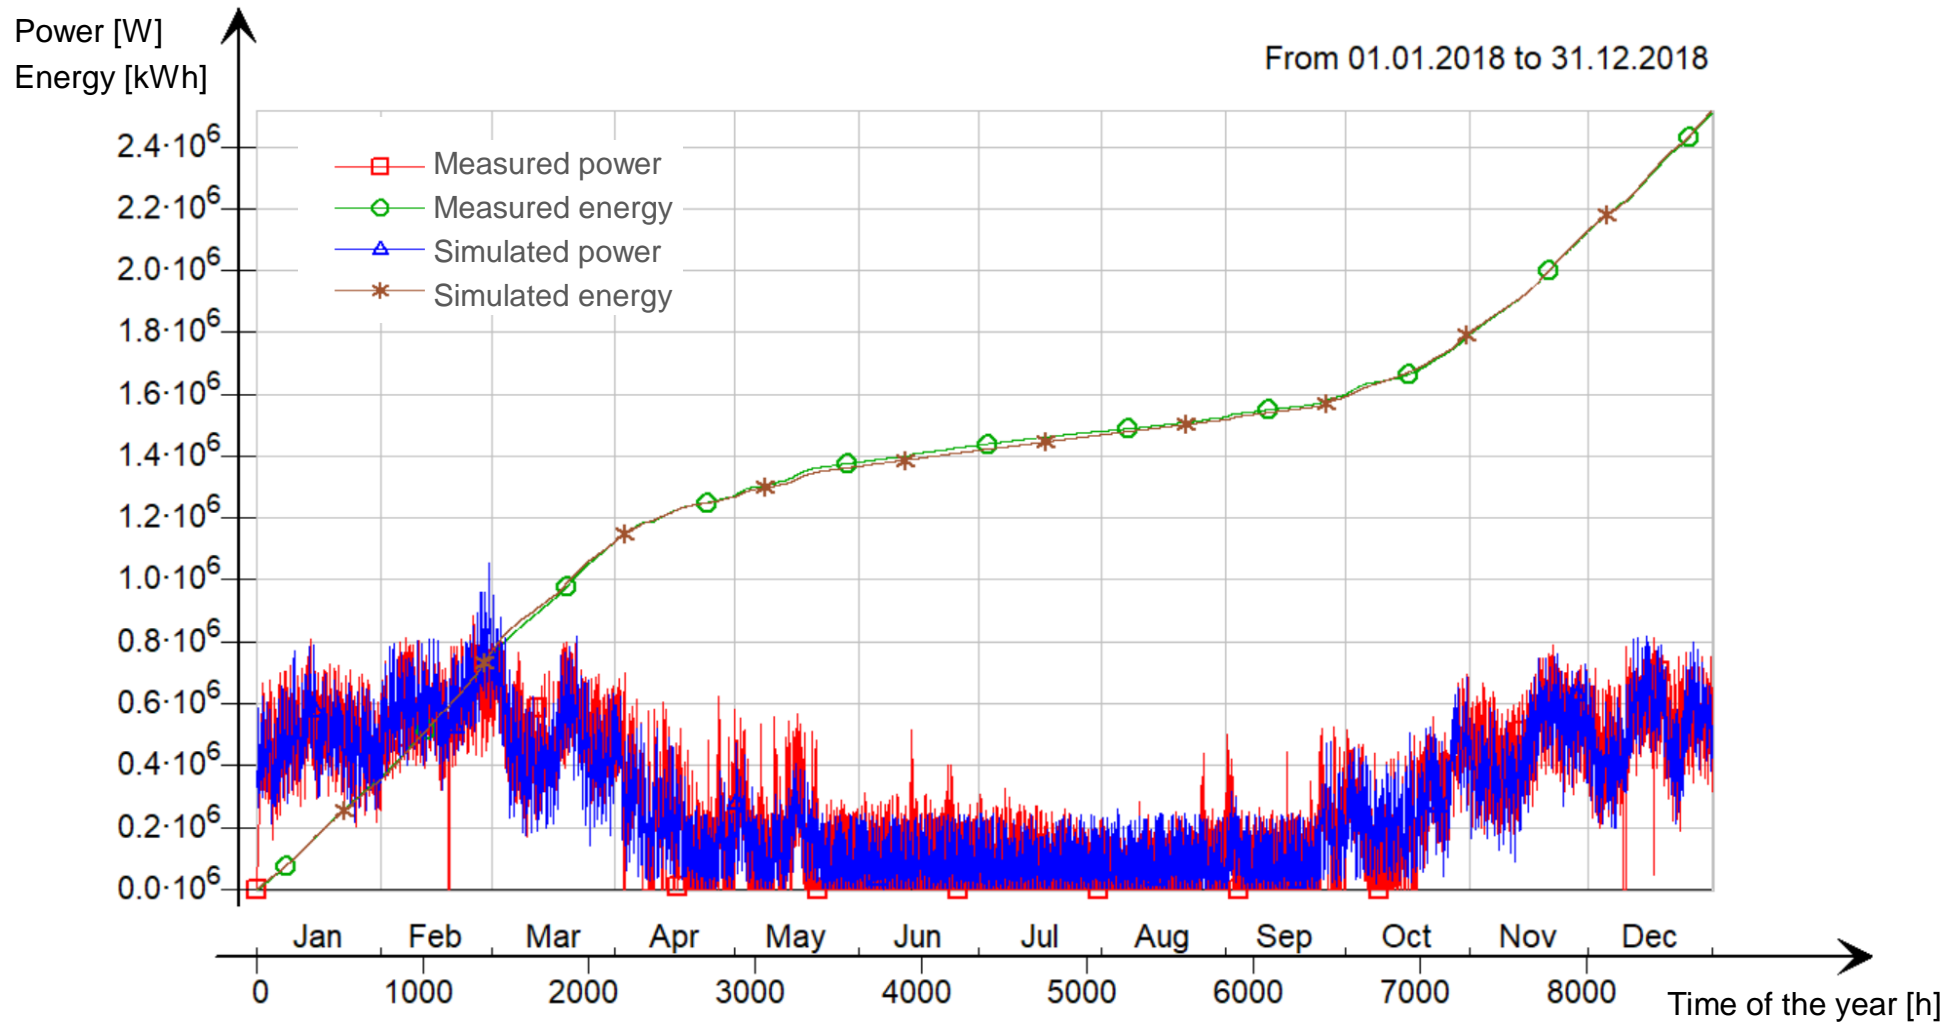

Regression analysis of the step response




Heat-up, cooldown & energy consumption of the water radiator system

Polynomial fit → forecast function

```
QheatUp= 2.15584648E+06-3.52022706E+04*TsolAir+1.07826465E+04*TsolAir^2-5.92177380E+02*TsolAir^3+8.19349342E-03*TsolAir^4-
3.977306055E+05*Troom+2.74946888E+04*Troom^2-8.46062071E+02*Troom^3+9.76334511E+00*Troom^4+4.76106227E+03*TsolAir*Troom-
2.14744593E+02*TsolAir*Troom^2+3.22977908E+00*TsolAir*Troom^3-1.47390145E+03*TsolAir^2*Troom+6.71208306E+01*TsolAir^2*Troom^2-
1.01838421E+00*TsolAir^2*Troom^3+8.10630646E+01*TsolAir^3*Troom-3.69752707E+00*TsolAir^3*Troom^2+5.61868526E-02*TsolAir^3*Troom^3
```

```
TheatUp= 2.37653466E+03-4.21996850E+01*TsolAir+1.10213082E+01*TsolAir^2-5.88336497E-01*TsolAir^3+8.02085476E-06*TsolAir^4-
4.37793363E+02*Troom+3.02760977E+01*Troom^2-9.30876559E-01*Troom^3+1.07321624E-02*Troom^4+5.72553903E+00*TsolAir*Troom-2.59091343E-
01*TsolAir*Troom^2+3.90956877E-03*TsolAir*Troom^3-1.50624143E+00*TsolAir^2*Troom+6.85831635E-02*TsolAir^2*Troom^2-1.04042710E-
03*TsolAir^2*Troom^3+8.05082754E-02*TsolAir^3*Troom-3.67088949E-03*TsolAir^3*Troom^2+5.57612325E-05*TsolAir^3*Troom^3
```

```
TcoolDown= 3.47464244E+03-3.06620129E+02*TsolAir-3.60096982E+01*TsolAir^2+2.89460565E+00*TsolAir^3+1.70047946E-03*TsolAir^4-
5.64658560E+02*Troom+3.39920929E+01*Troom^2-8.94212139E-01*Troom^3+8.63073547E-03*Troom^4+4.75577965E+01*TsolAir*Troom-
2.43993288E+00*TsolAir*Troom^2+4.14605840E-02*TsolAir*Troom^3+5.20100536E+00*TsolAir^2*Troom-2.49862326E-01*TsolAir^2*Troom^2+3.97571792E-
03*TsolAir^2*Troom^3-4.37429828E-01*TsolAir^3*Troom+2.21301355E-02*TsolAir^3*Troom^2-3.74178008E-04*TsolAir^3*Troom^3
```

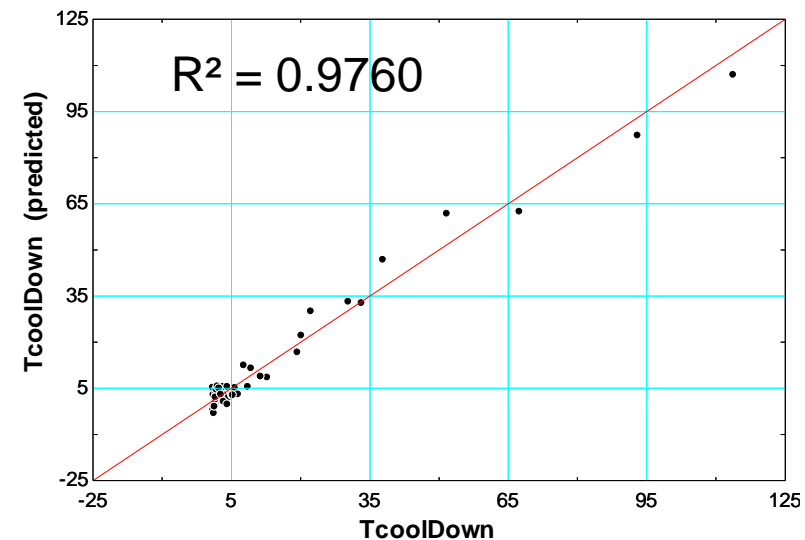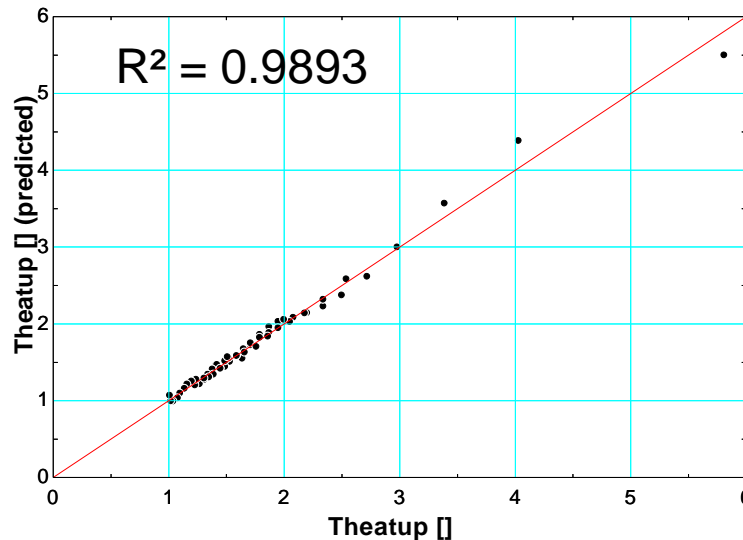
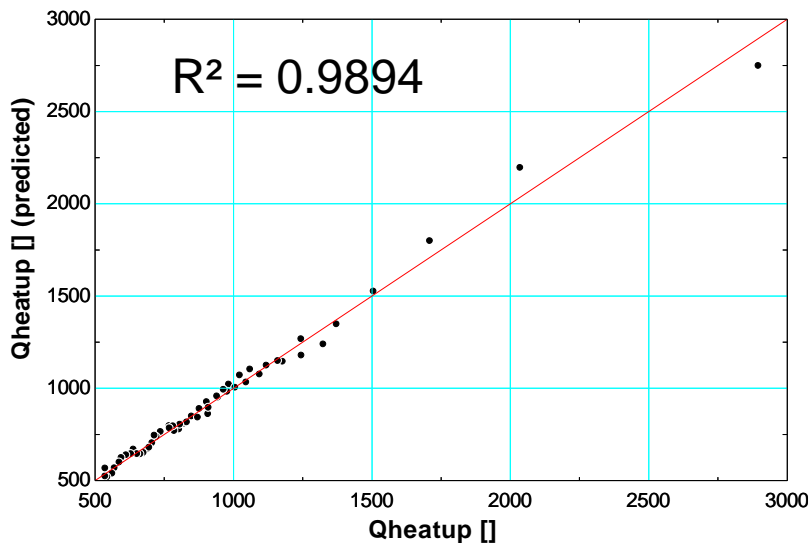


ToDo's

- Simplified model needs to be assessed
 - Comparison of high and low detail simulation → how much simplification is possible?
- Work flow needs to be optimized
 - Raise degree of automatization
 - Improve simulation model for applied studies
- Further investigations regarding system flexibilities
 - Evaluation of the determined KPIs
 - Future design of 5GDHC-networks
 - Forecasts on revenues & possibilities of business models
- Implementation of Model Predictive Control
 - Application of characteristic diagrams and forecast functions

Sun-air temperature

Super positioning of horizontal global irradiation & ambient air temperature

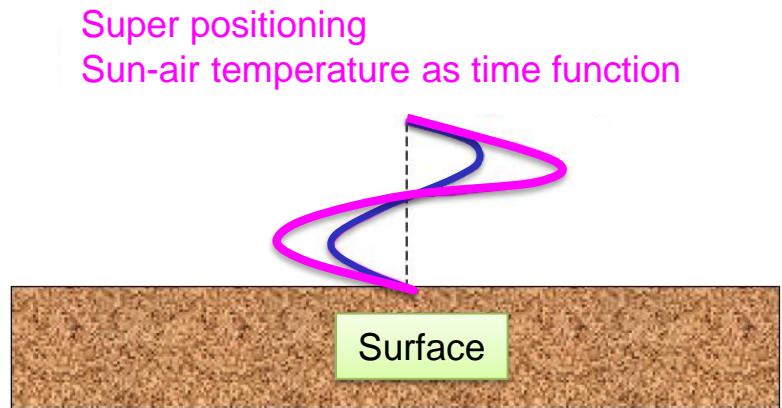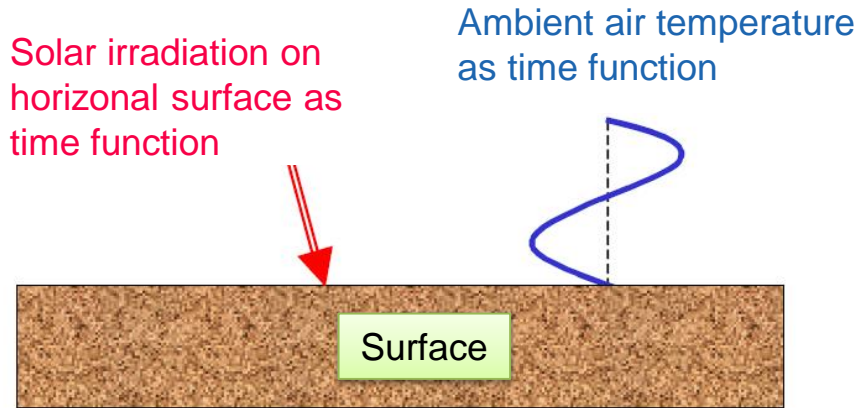


$$t_{out}(\tau) = t_L(\tau) + \frac{a \dot{I}_{total}(\tau)}{\alpha_a}$$

$a = 0.5 -$
 $\alpha_a = 20 \text{ W/m}^2\text{K}$

$t_{out}(\tau)$	°C	Ambient temperature as sun-air temperature
$t_L(\tau)$	°C	Ambient air temperature
a	-	Absorption coefficient of surface
\dot{I}_{total}	W/m ²	Horizontal global irradiation
α_a	W/(m ² K)	Heat transfer coefficient of surface

Based on source:
Bernd Glück, 2018: Wärmetechnische Vorgänge in einer Außenwand ohne und mit Dämmung sowie Anwendung des U-Wertes
www.berndglueck.de

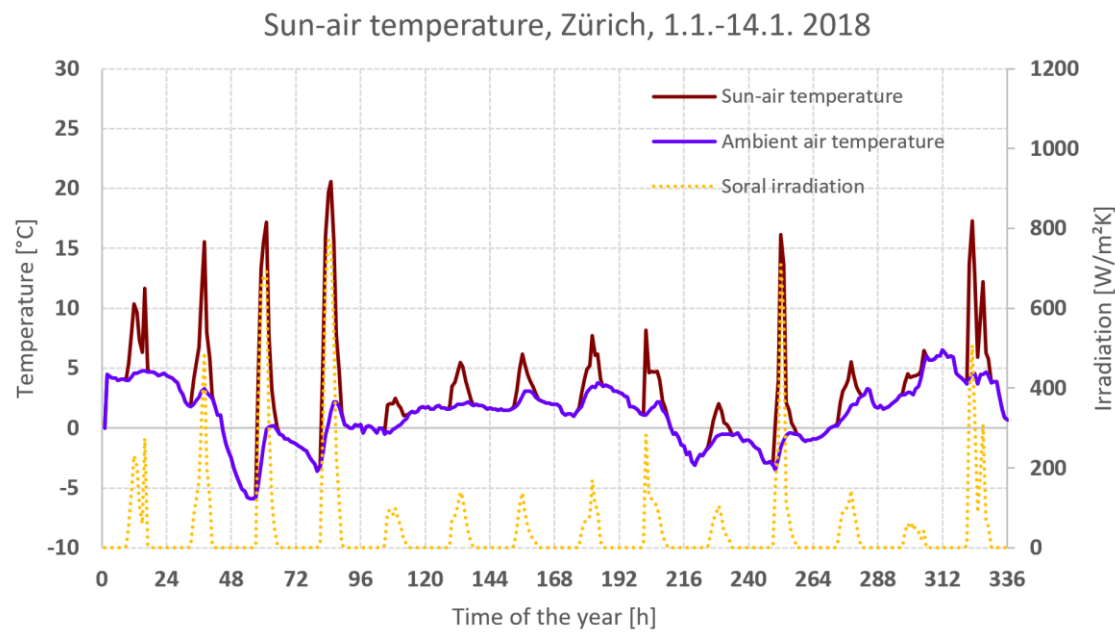


Results of the step response test

Cool down test, 24°C to 20°C, varying heating systems


Cooldown test

Water radiator system, 0% cloud cover and 10°C sun-air temperature

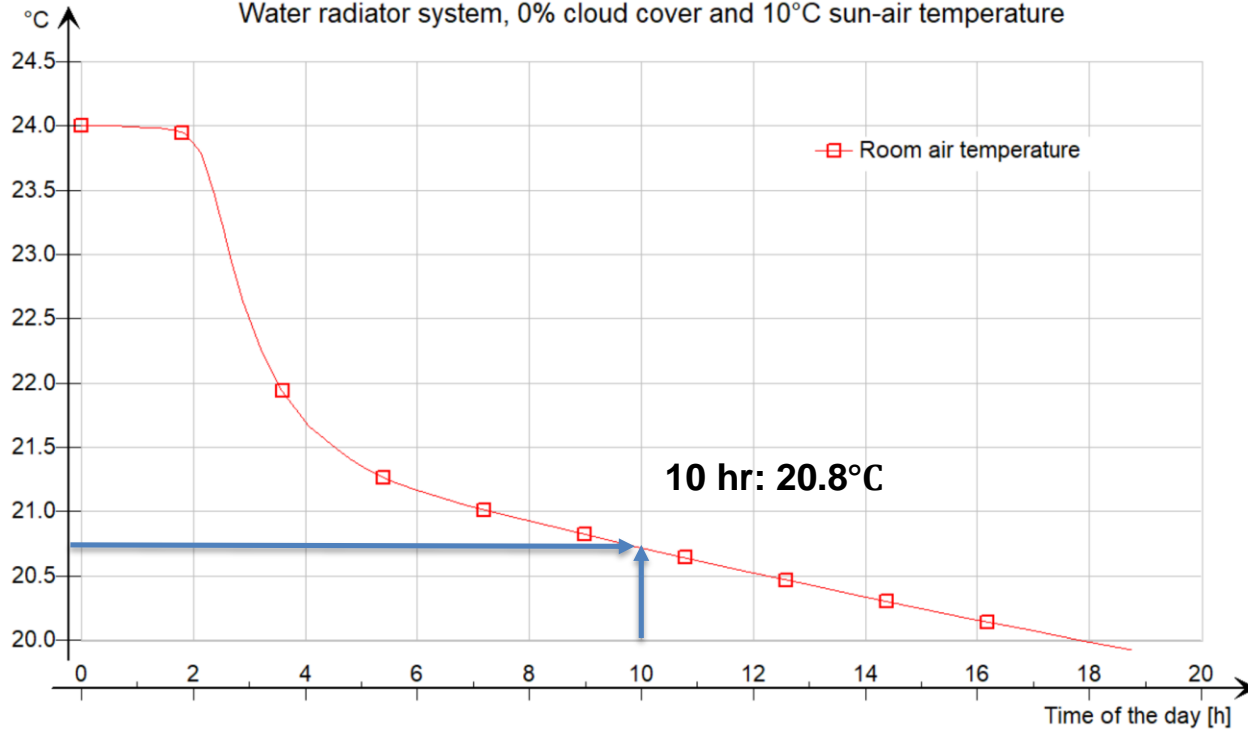



Cooldown test

Floor heating system, 0% cloud cover and 10°C sun-air temperature

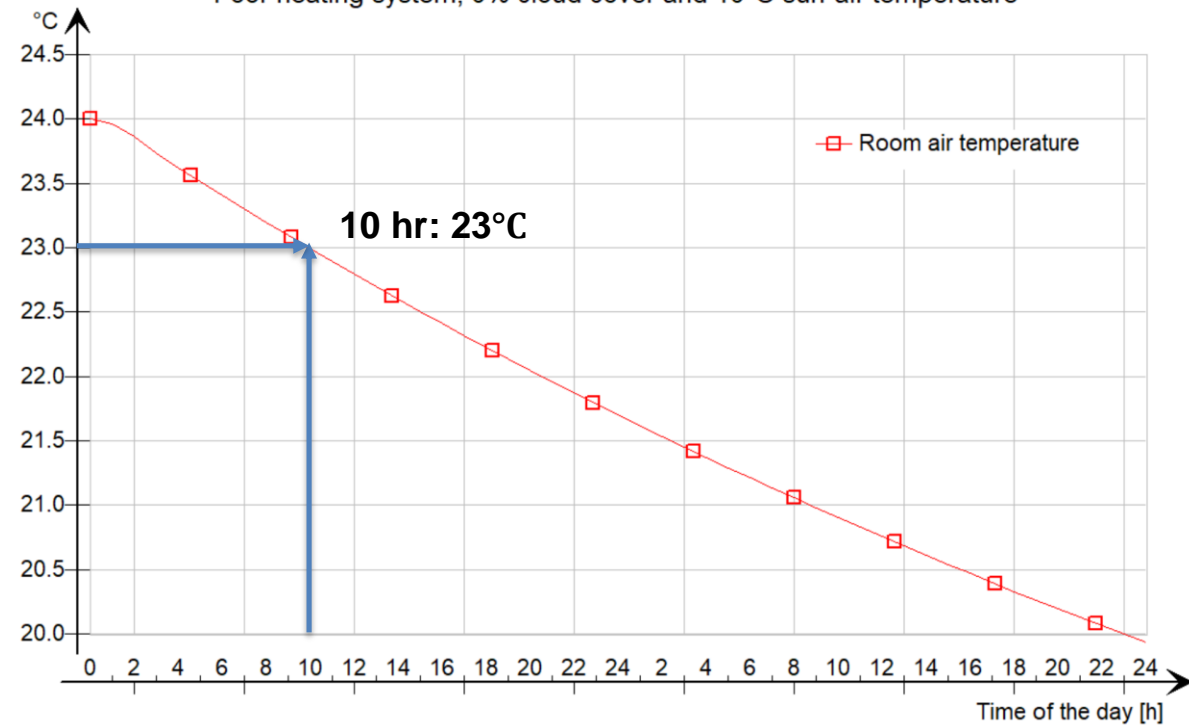


Results of the step response test

Heat up test, 20°C to 24°C, with varying heating systems

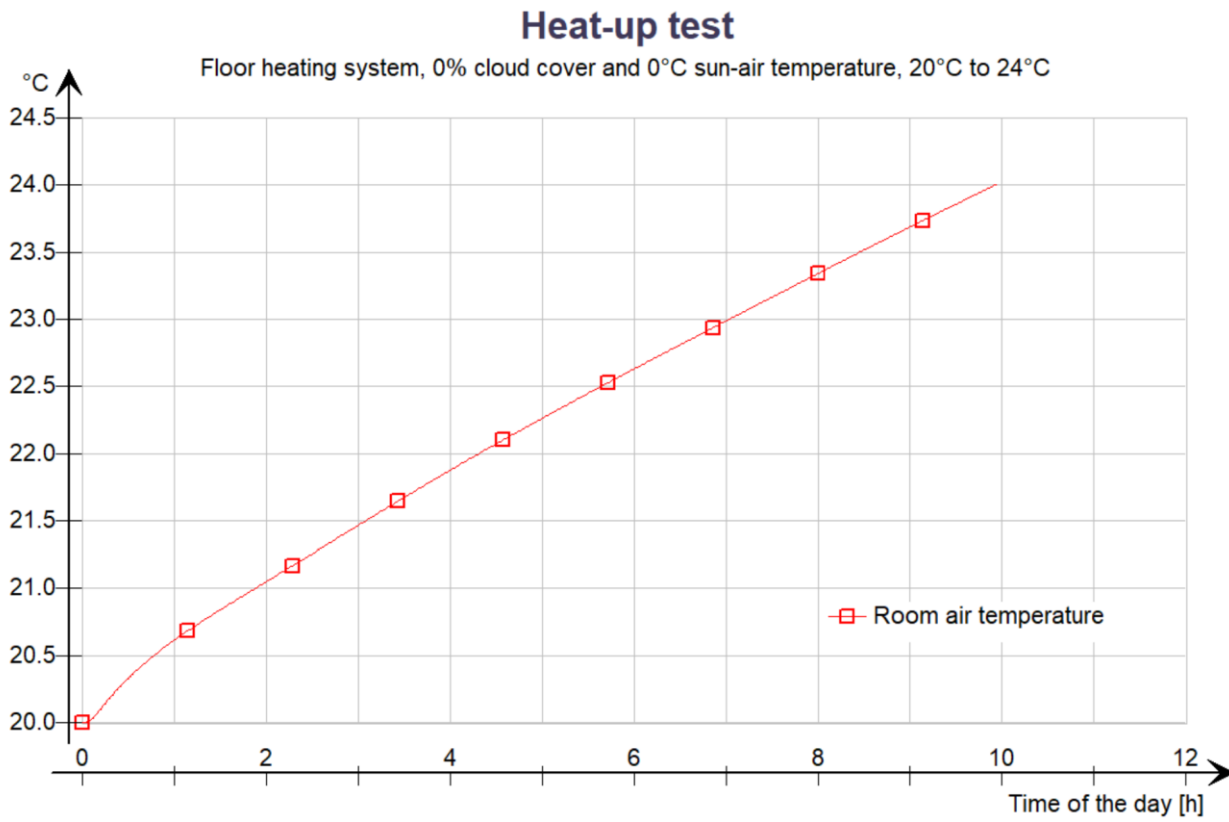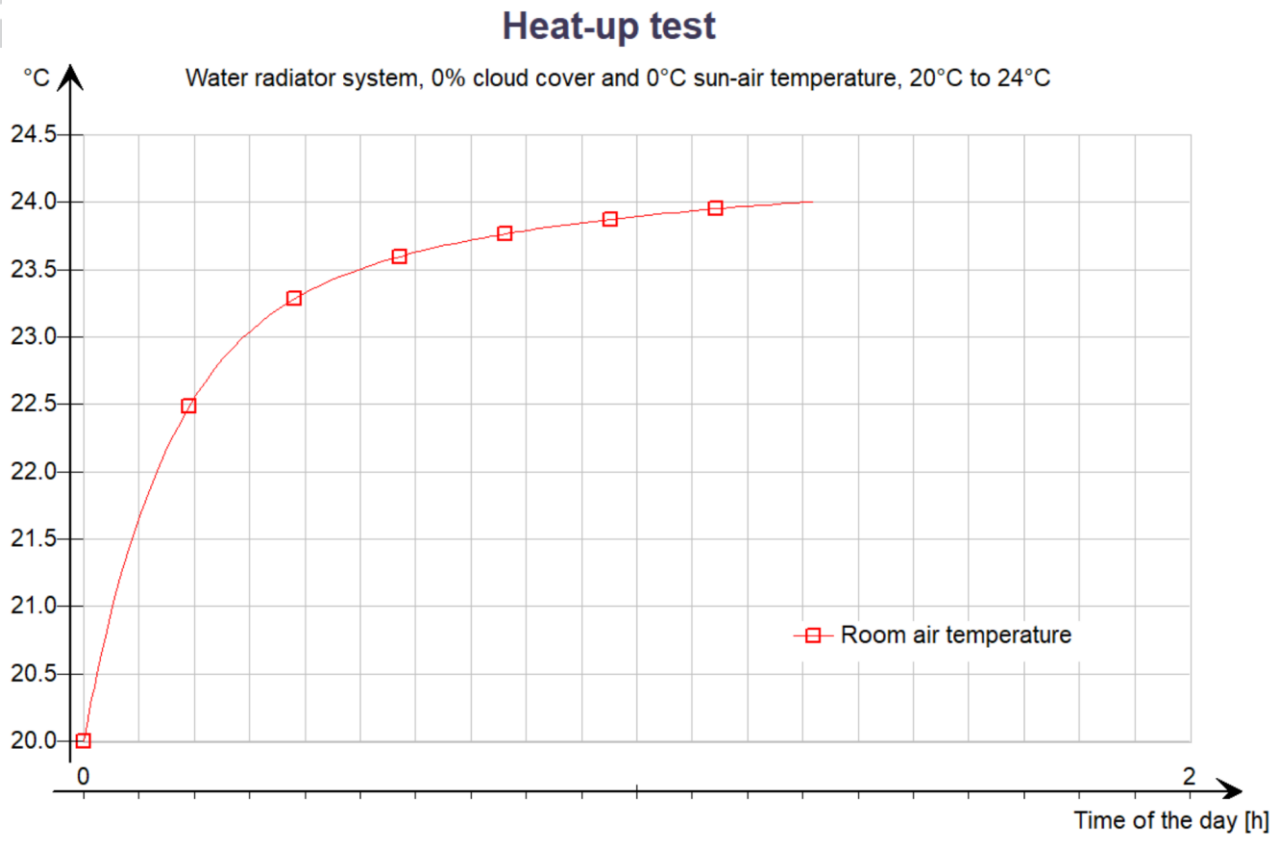

Characteristic diagrams of the step response test


Heat-up, electrical energy consumption of the heat pump

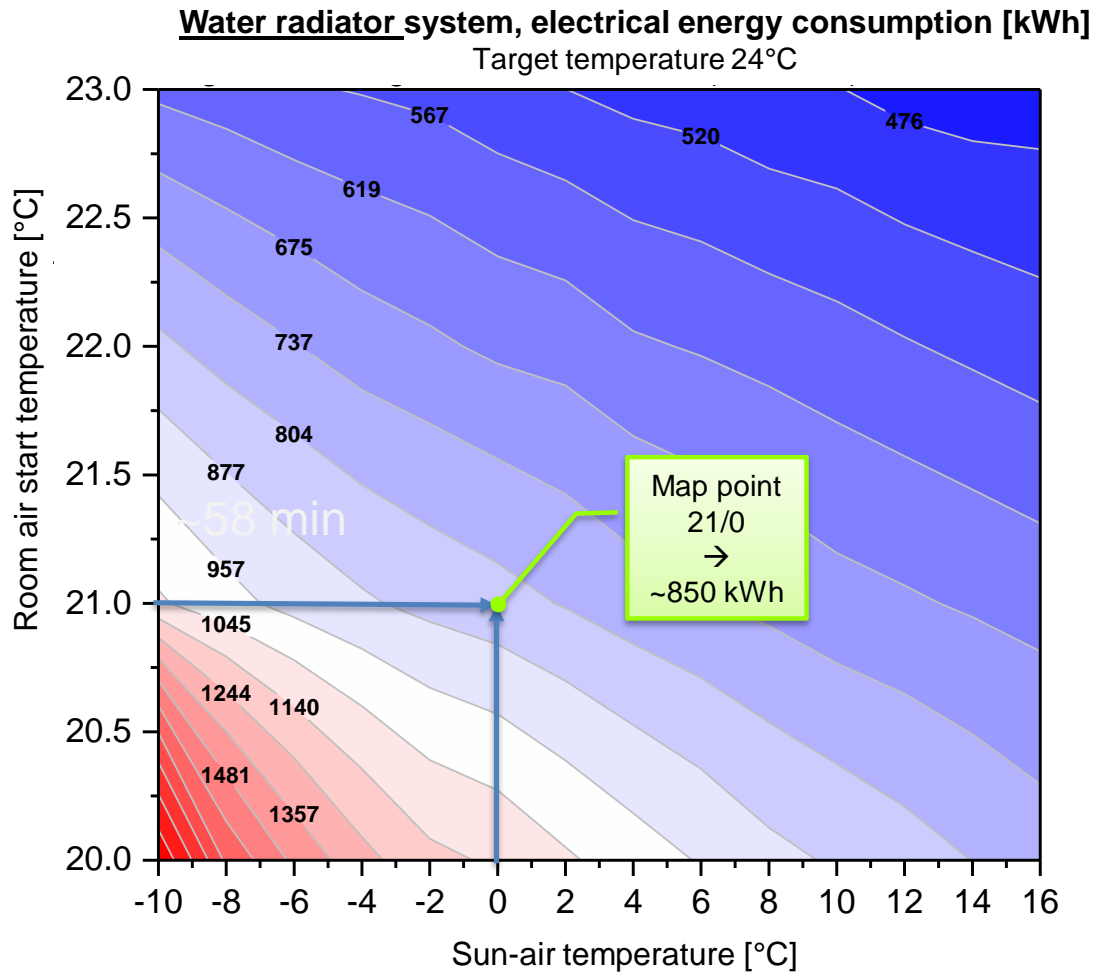

24 °C

↑

20 - 23 °C

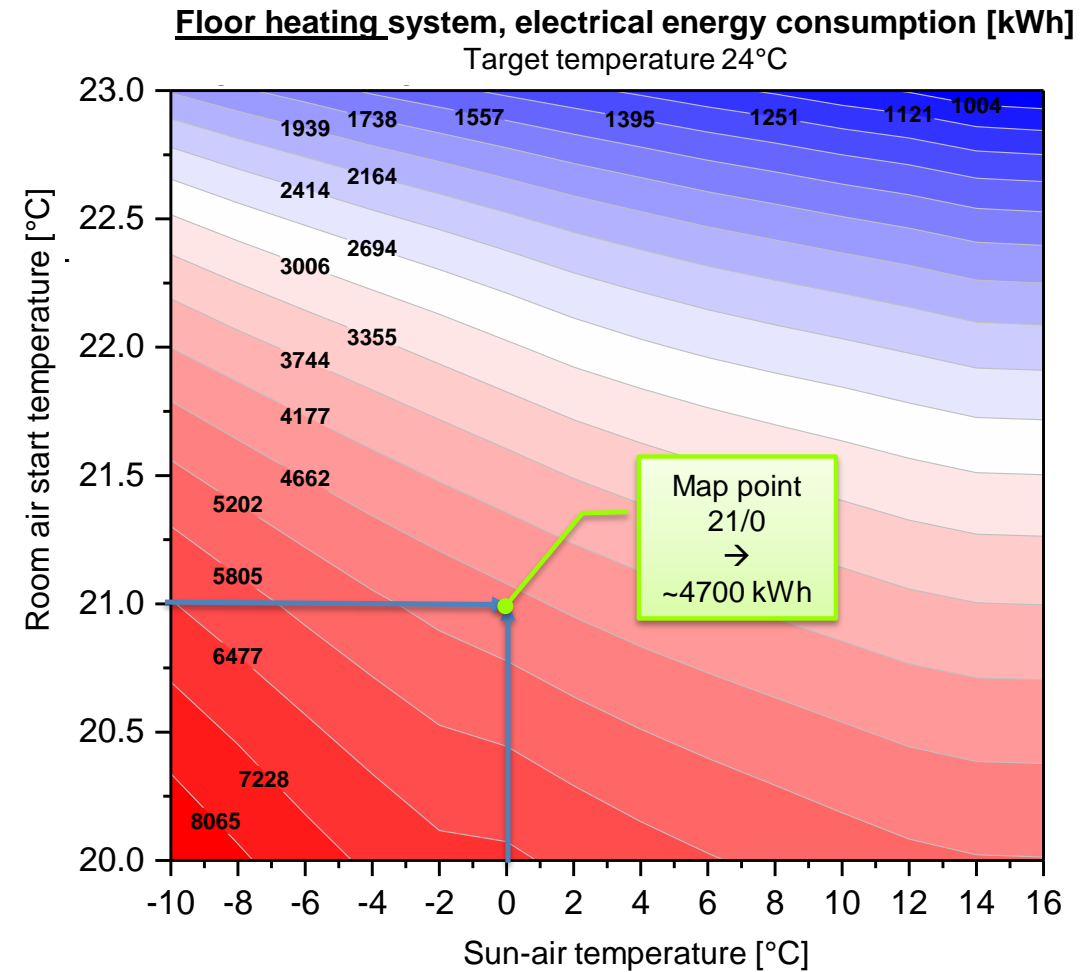

Characteristic diagrams of the step response test

Water radiator system, heat-up and cooldown time

